



S:\ACAD\40623\MZ-2.dwg, Model: 1/7/2004 3:27:15 PM, ghessef, auct024MONO.Dwg

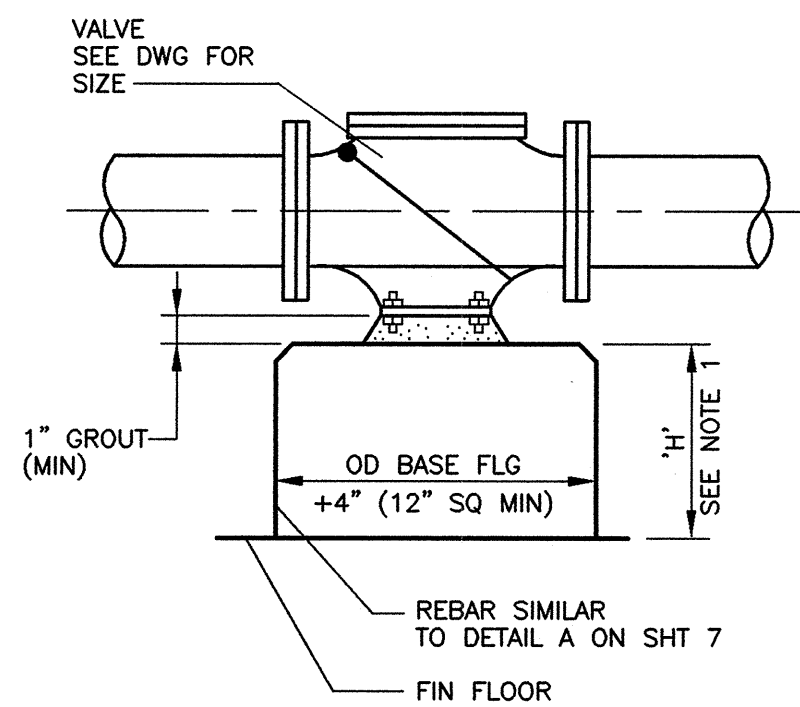


NOTE
1 'H' AS REQUIRED FOR EQUIPMENT FURNISHED TO MATCH
ELEVATIONS SHOWN.

VALVE SUPPORT
DETAIL A
NTS

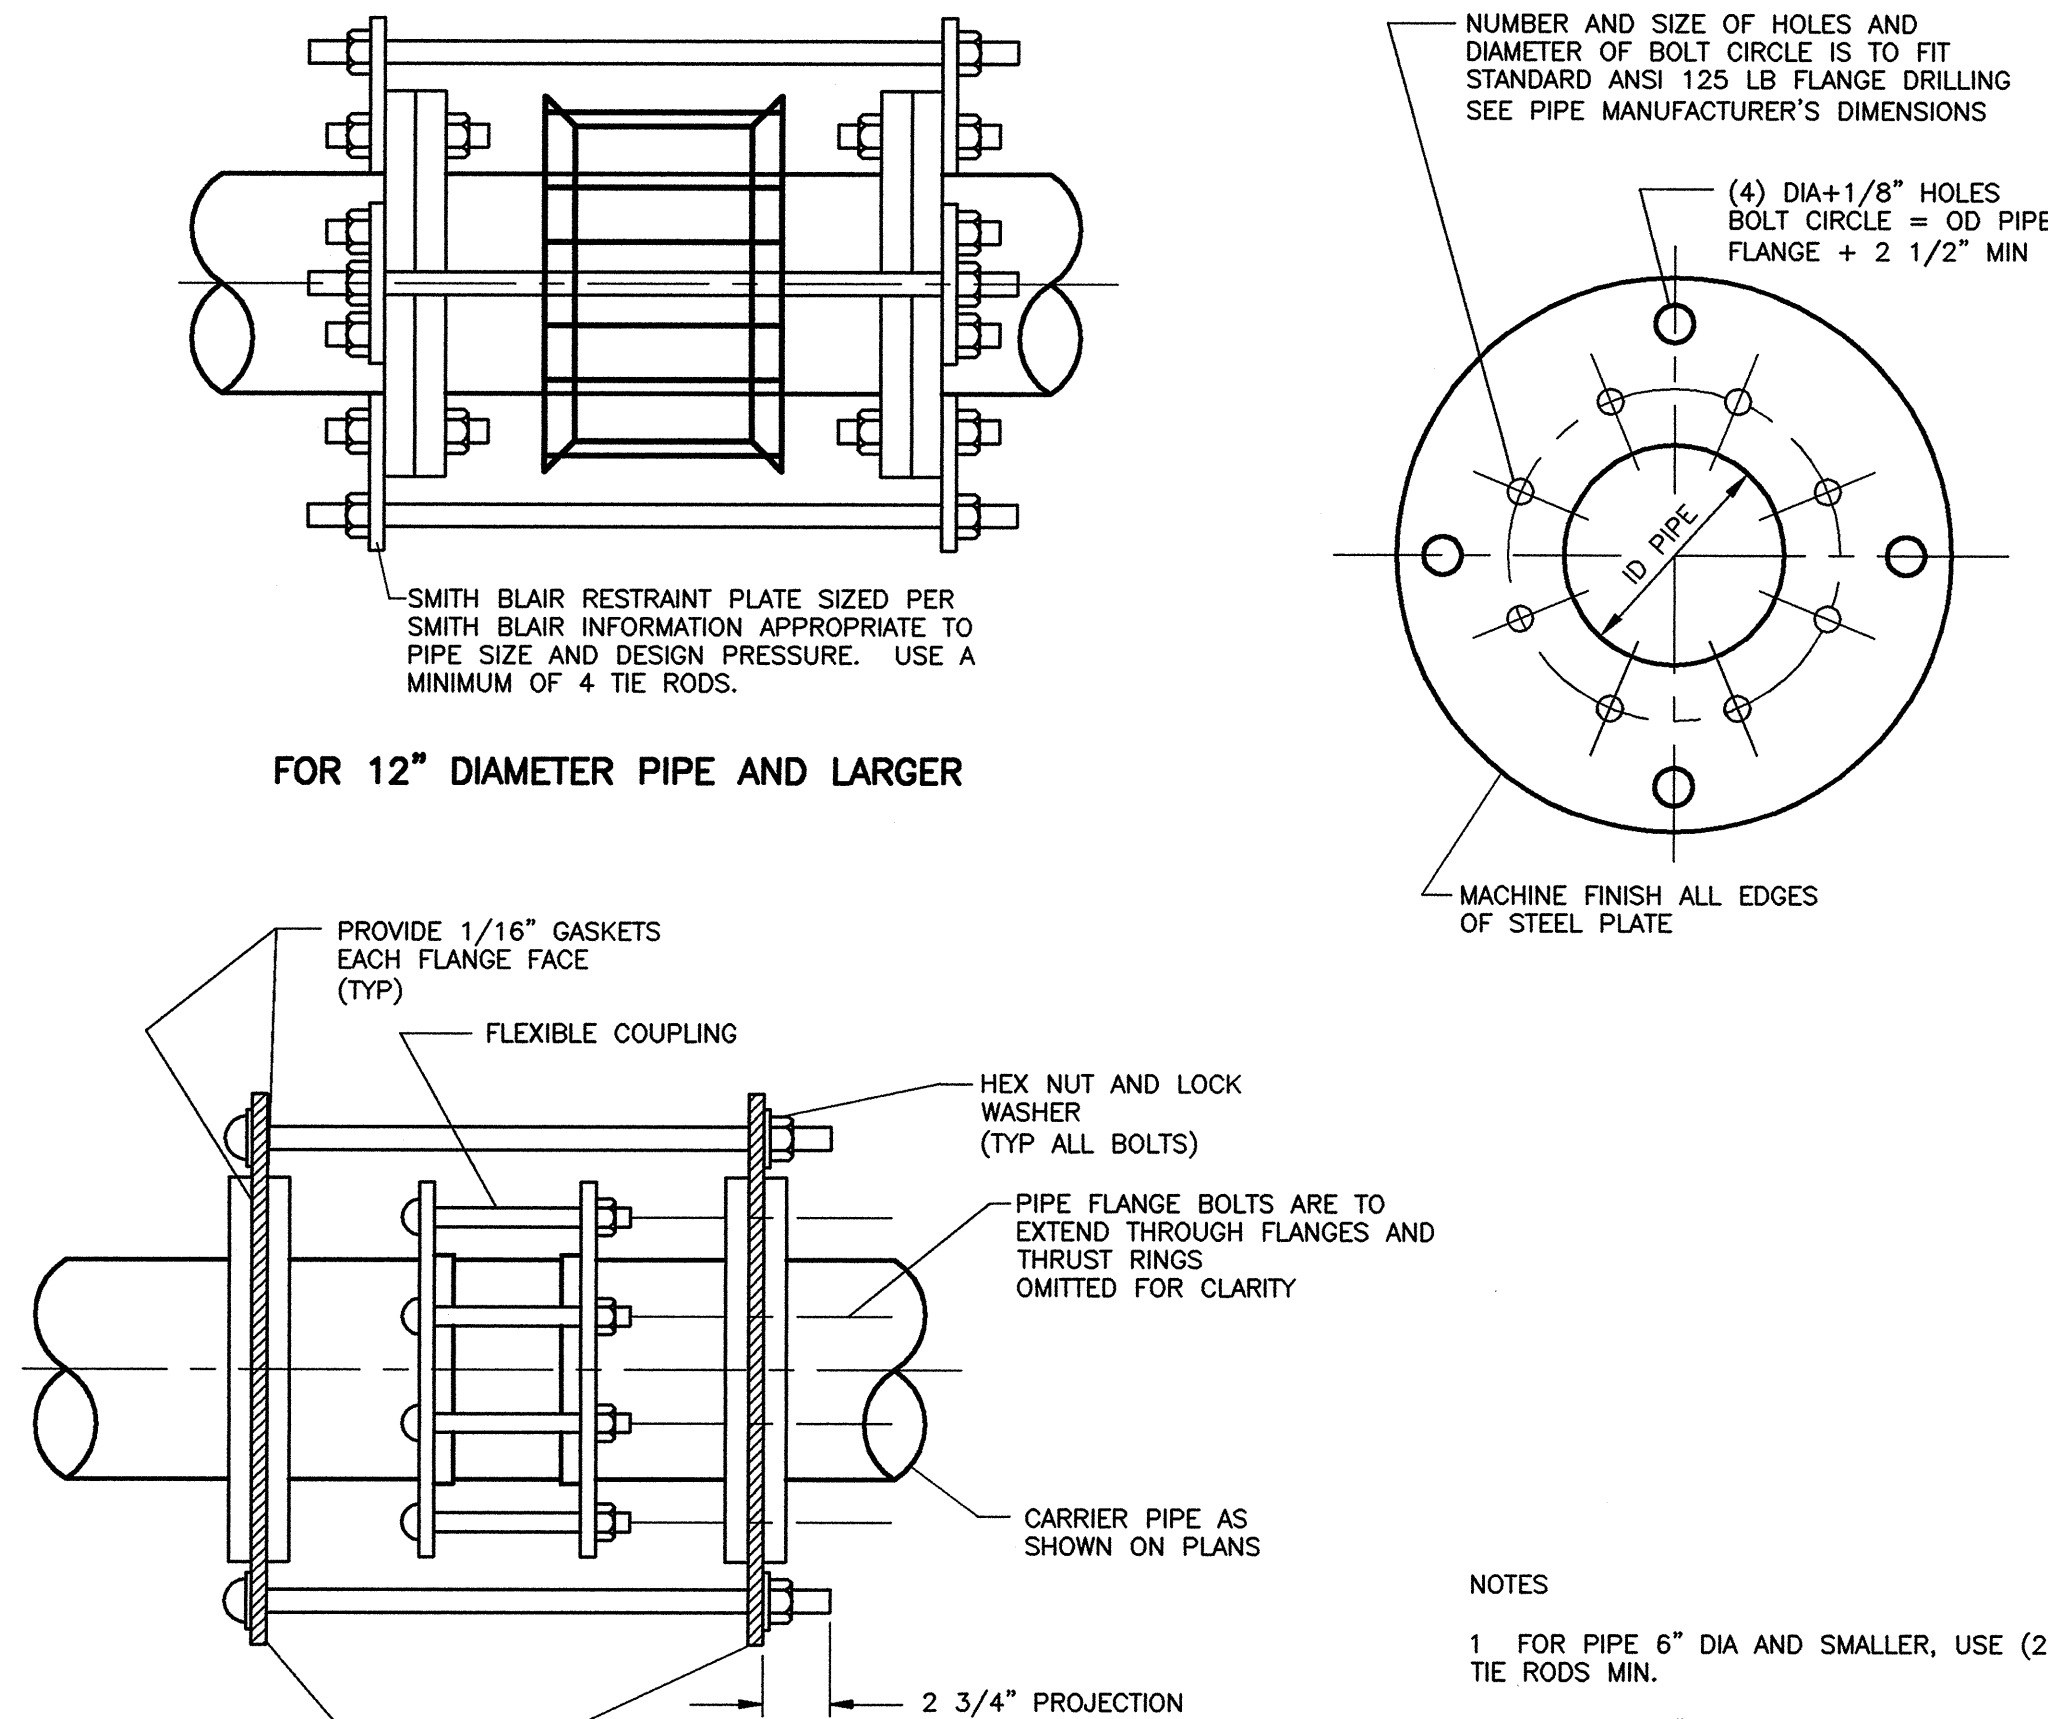


NOTES
1 FOR PIPE 6" DIA AND SMALLER, USE (2) 3/4" DIA
TIE RODS MIN.
2 FOR PIPE 8" DIA AND LARGER, USE (4) 1" DIA TIE
RODS MIN.

THRUST HARNESS FOR FLEXIBLE COUPLING
DETAIL B
NTS

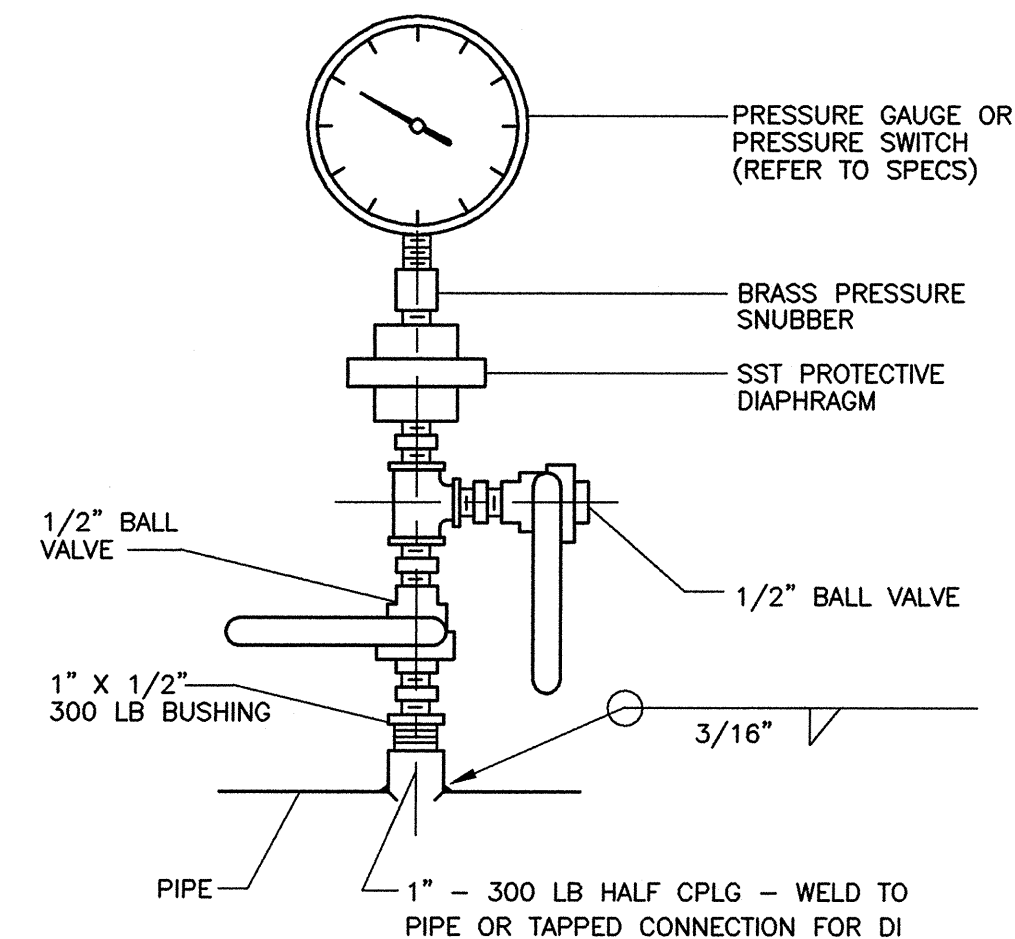

NOTE
1 USE DIAPHRAGM SEALS AND VALVES FOR ALL CHEMICALS,
SEWAGE, SLUDGE AND OTHER LIQUIDS CONTAINING SOLIDS.

PRESSURE GAUGE OR SWITCH
DETAIL C
NTS

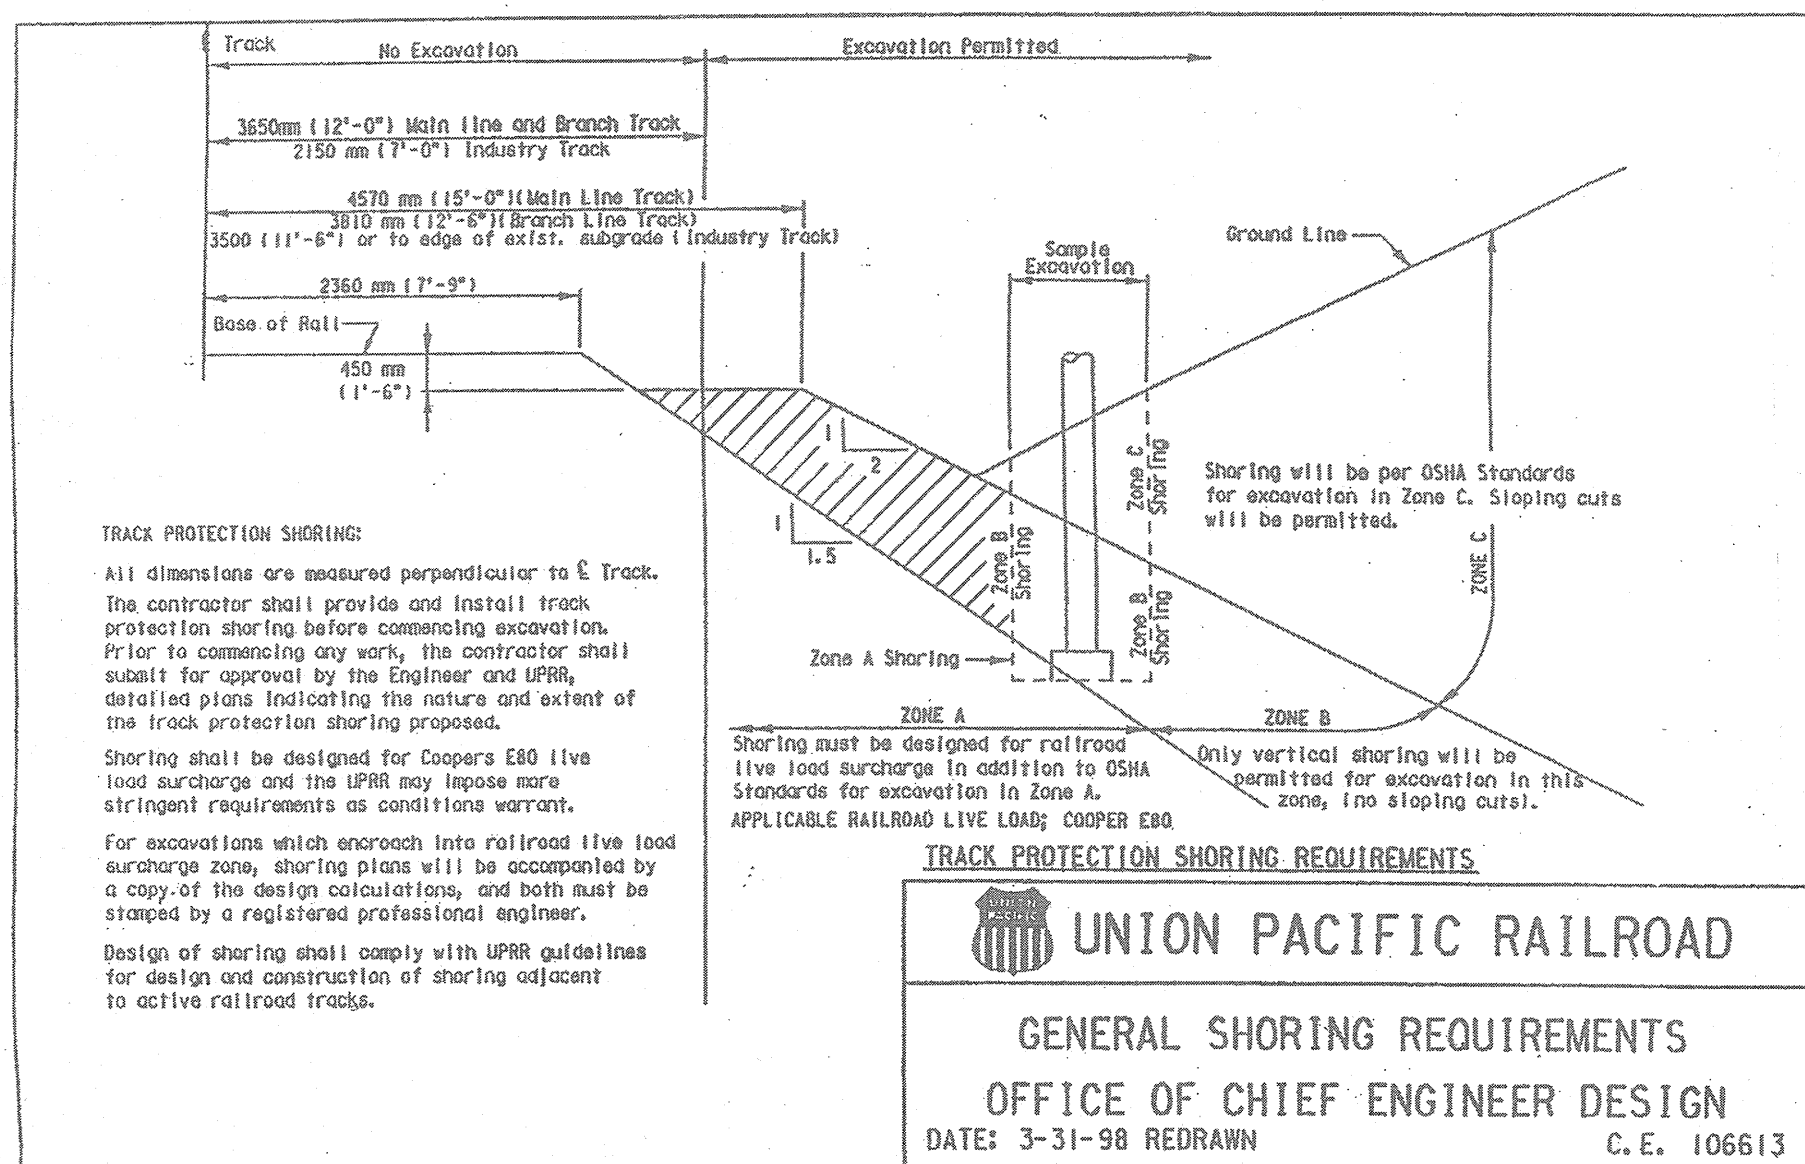

GENERAL SHORING REQUIREMENTS
DETAIL D
NTS

X-PSBORD

REV	No	DATE	DRWN	CHKD	REMARKS

DESIGNED BY: CDM
DRAWN BY: CDM
SHEET CHK'D BY: TOWER
CROSS CHK'D BY: WOELKE
APPROVED BY:
DATE: JANUARY 2004

CDM Camp Dresser & McKee Inc.
consulting
engineering
construction
operations

CITY OF BRYAN, TEXAS
MAIN STREET
PUMP STATION IMPROVEMENTS

STANDARD DETAILS II

PROJECT No 40623
FILE NAME: MZ-2

SHEET No

9

